

TABLE OF DIMENSIONAL REQUIREMENTS
ZONE RB (RESIDENCE B)

	REQUIRED	EXISTING	PROPOSED LOT 1	PROPOSED LOT 2
MIN LOT AREA (SQ. FEET)	10,000	23,707.54	11,426.67	12,278.37
MIN. LOT FRONTAGE (FEET)	50	133.17	66.14	67.04
FRONT YARD TO LOT LINE (FEET)	33.5	44.10	33.50	33.50
FRONT YARD TO SIDEWALK EDGE (FEET)	40	-	40	40
SIDE YARD (FEET)	15	43.30	15	15
TOTAL SIDE YARDS (FEET)	30	104.20	30	30
REAR YARD (FEET)	40	44.1	40	40
MAX. COVERAGE	50%	16.25%	42.26%	42.69%
MAX. BUILDING HEIGHT (FEET)	2.5 STORIES	2 STORY	TBD	TBD


PARKING SPACE REQUIREMENTS

2 SPACES PER UNIT
LOT 1
 REQUIRED: 2 UNITS X 2 SPACES/UNITS
 4 SPACES
 PROVIDED: 4 UNITS
LOT 2
 REQUIRED: 2 UNITS X 2 SPACES/UNITS
 4 SPACES
 PROVIDED: 4 UNITS

WALL NOTES

- BUILDING FOOTING AND FOUNDATIONS SHOULD NOT BE PLACED HIGHER THAN ANY NEARBY WALL.
- THE WALLS SHALL BE BUILT LAST AND NO CONSTRUCTION EQUIPMENT SHALL EVER BE PLACED ON TOP OF WALL.
- GLOBAL STABILITY ANALYSIS HAS NOT BEEN INCLUDED AS PART OF THIS DESIGN. THE NEED FOR FURTHER EVALUATION CAN BE DETERMINED DURING CONSTRUCTION AS DICTATED BY FIELD CONDITIONS.
- SEE ACCOMPANYING WALL DESIGN PACKAGE FOR EXACT SPECIFICATIONS PER SECTION INCLUDING BUT NOT LIMITED TO GEOGRID SPACING AND BURIED BLOCK DEPTH.

- NOTES:**
- BOUNDARY AND TOPOGRAPHY TAKEN FROM SURVEY BY JOHN W. McCORD, Sr. P.L.S. LIC# 050904, DATED JUNE 24, 2024.
 - THE HORIZONTAL AND VERTICAL LOCATION OF EXISTING SUBSURFACE UTILITIES HAVE BEEN DETERMINED FROM DATA PROVIDED BY OTHERS. IT WILL BE THE RESPONSIBILITY OF THE CONTRACTOR TO PROTECT ALL EXISTING UTILITIES WITHIN THE AREA OF CONSTRUCTION THAT ARE TO REMAIN IN SERVICE. CONTRACTOR SHALL VERIFY SIZE AND LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION.
 - THE EXISTING GAS AND ELECTRIC UTILITIES MUST BE LOCATED AND MARKED BEFORE CONSTRUCTION CAN START.
 - IT IS RECOMMENDED TO USE LEAF GUARD OR A SIMILAR PRODUCT ON ALL GUTTERS.
 - FOR ALL UTILITY CONSTRUCTION & IMPROVEMENTS, THE APPLICANT SHALL RESTORE ALL PAVEMENT, CURB, SIDEWALK, ETC. TO MATCH THE EXISTING CONDITIONS.
 - NO TREE CUTTING BETWEEN APRIL 1ST AND OCTOBER 1ST.
 - THE PROPERTY CANNOT BE RE-SUBDIVIDED.
 - MILL AND REPAIR THE ROAD AT THE FRONT OF THE TWO UNITS WHEN EXCAVATION IN THE ROADS IS COMPLETE.
 - SPECIAL INSPECTION ON RETAINING WALLS IS REQUIRED AS WELL AS A WRITTEN SIGN OFF BY THE SPECIAL INSPECTOR WITH GEO STUDY.

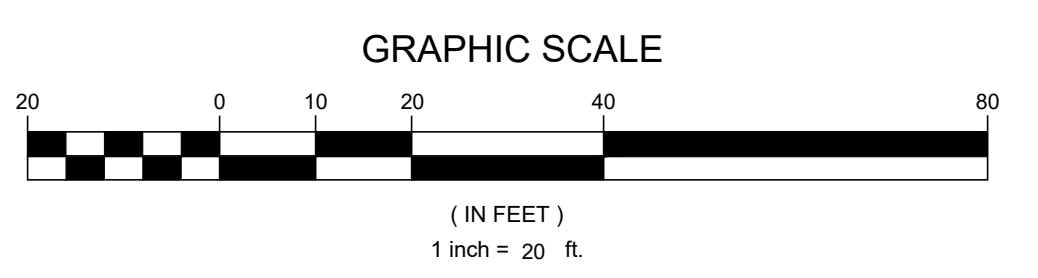

TERRANOVA ENGINEERING CONSULTANTS DPC NEW YORK LICENSE No. 0022578
 71 LAFAYETTE AVE., SUFFERN, NY 10901 SUITE #104 INFO@TERRANOVA.COM P: (845) 666-0155

NO.	REVISION	DATE	DR/CK

JOSIP MEDIC, PE




LIC. 103757 DATE 08/07/2025

Legend

- Federal Highway
- State Route
- County Road
- Local Road
- Parcels
- Municipal Boundaries

Zoning Overlay Districts

- Scenic Gateways Overlay
- Scenic Roads Overlay
- Surface Water Overlay
- Ridgeline Overlay/Significant Biological Overlay
- Scenic Viewshed Overlay/Significant Biological Overlay

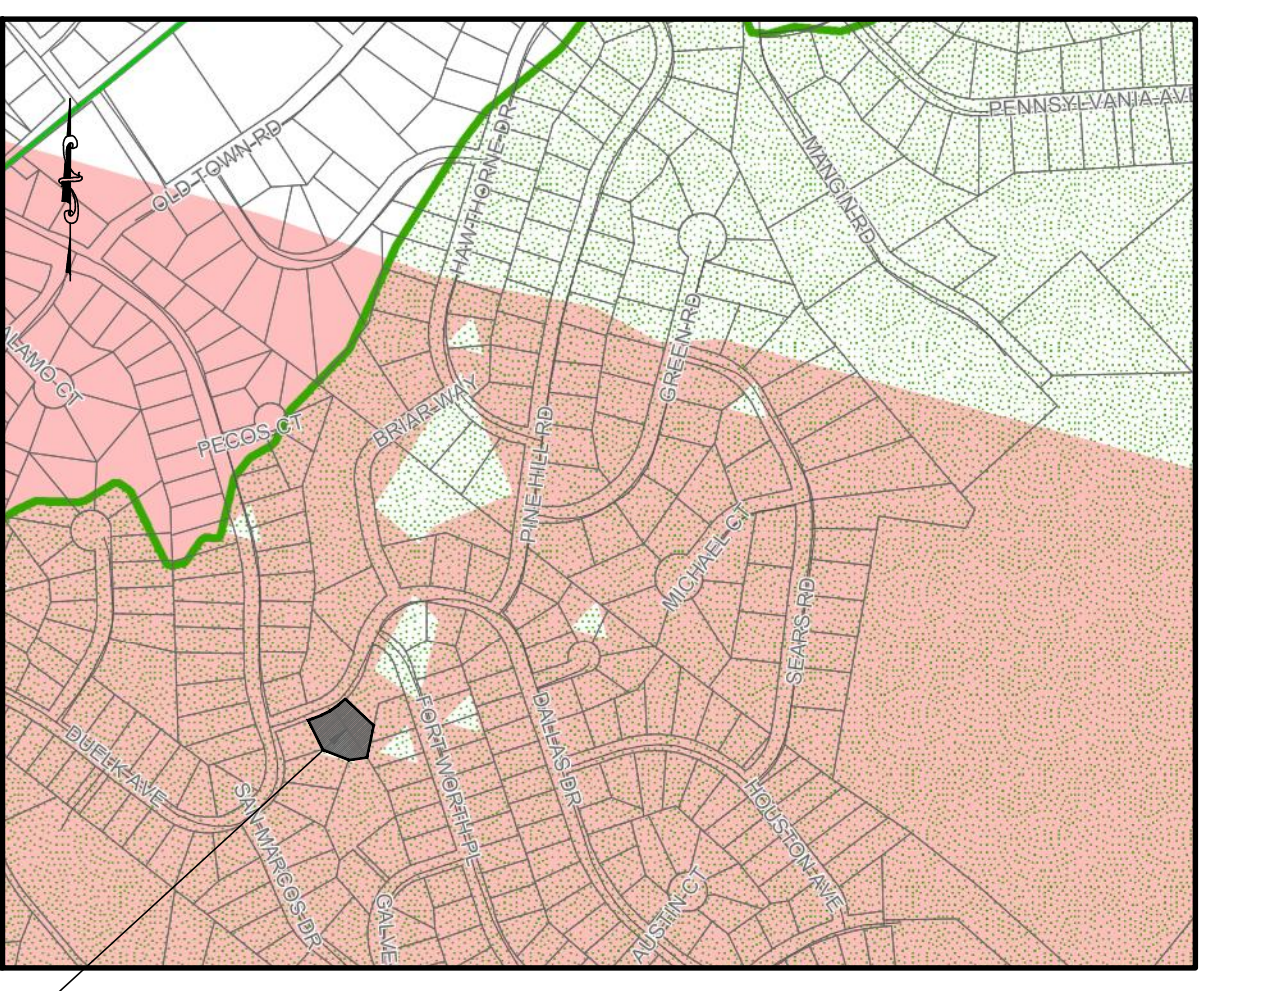

- SHEET INDEX:**
- SITE PLAN
 - DEMOLITION PLAN
 - GRADING PLAN
 - DRAINAGE PLAN
 - UTILITY PLAN
 - SOIL EROSION & SEDIMENT CONTROL PLAN
 - DETAILS SHEET

OVERLAY DISTRICT MAP NTS




SITE PLAN

DESIGN BY:	DRAWN BY:	CHECKED BY:
YB	EB	JM

4 DALLAS DRIVE
 4 DALLAS DRIVE, VILLAGE OF SOUTH BLOOMING GROVE,
 ORANGE COUNTY, NEW YORK 10950
 SBL 221-2-5 & 6

DRAWING NUMBER:	SCALE:	FILE NO.:	DATE:
01 OF 07	1"=20'	25155	08/07/2025

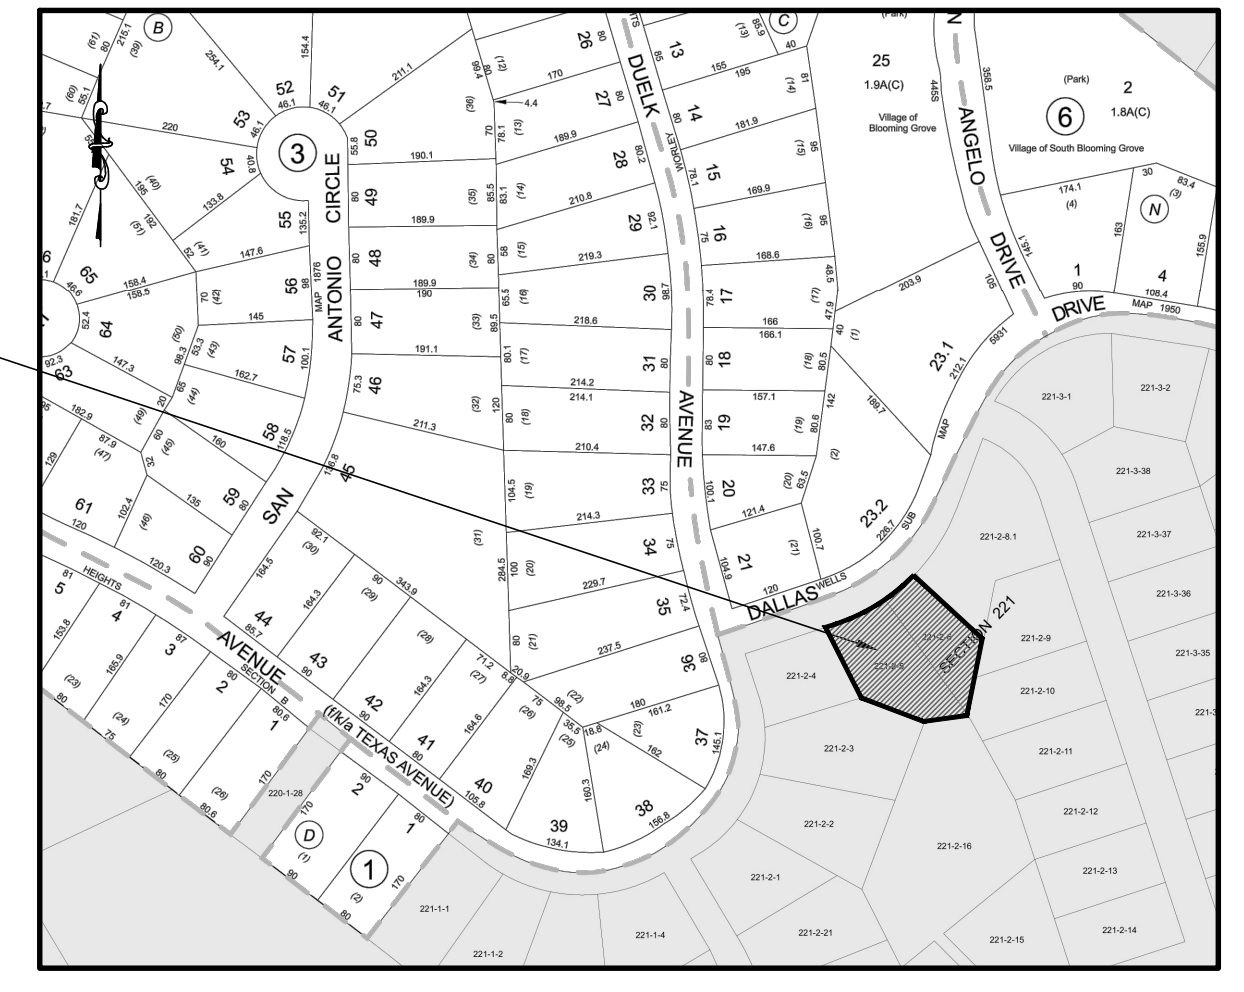


VICINITY MAP NTS

Legend

- State Route
- County Road
- Local Road
- Parcels
- Municipal Boundary

Zoning District

- RR
- RC-1
- RC-2
- ORI
- RB
- R-M

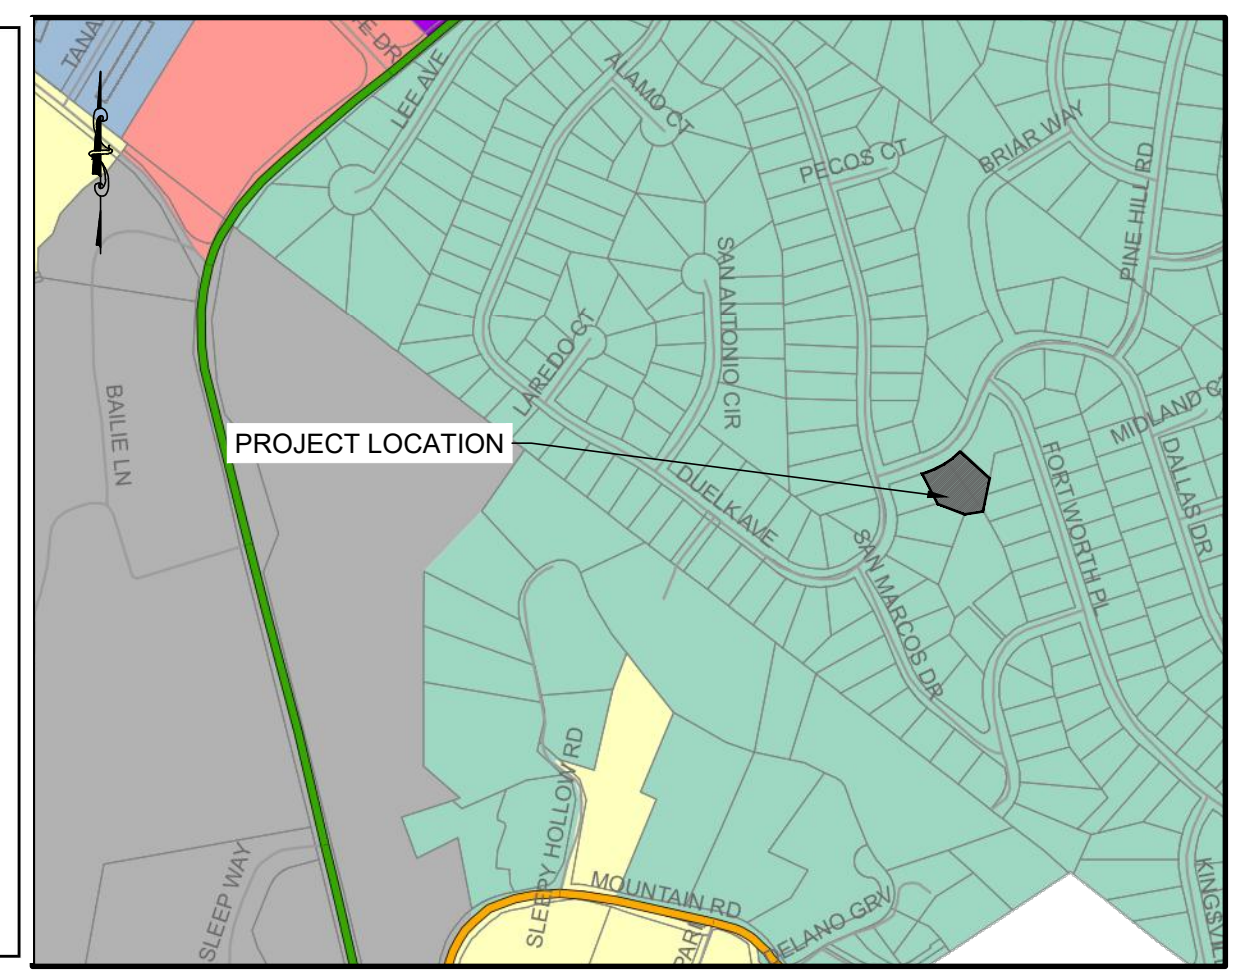


ZONE MAP NTS


PLANNING BOARD SIGNATURE

PLANNING BOARD CHAIRMAN _____ SIGNATURE DATE _____
 THIS IS TO CERTIFY THAT THIS SITE PLAN DATED _____ HAS BEEN APPROVED BY THE PLANNING BOARD BY A RESOLUTION OF APPROVAL DATED _____

HEREBY CONSENT TO THE FILING OF THIS SITE PLAN INCLUDING ALL DESIGN CONCEPTS, NOTES, STIPULATIONS AND OTHER INFORMATION INDICATED THEREON.

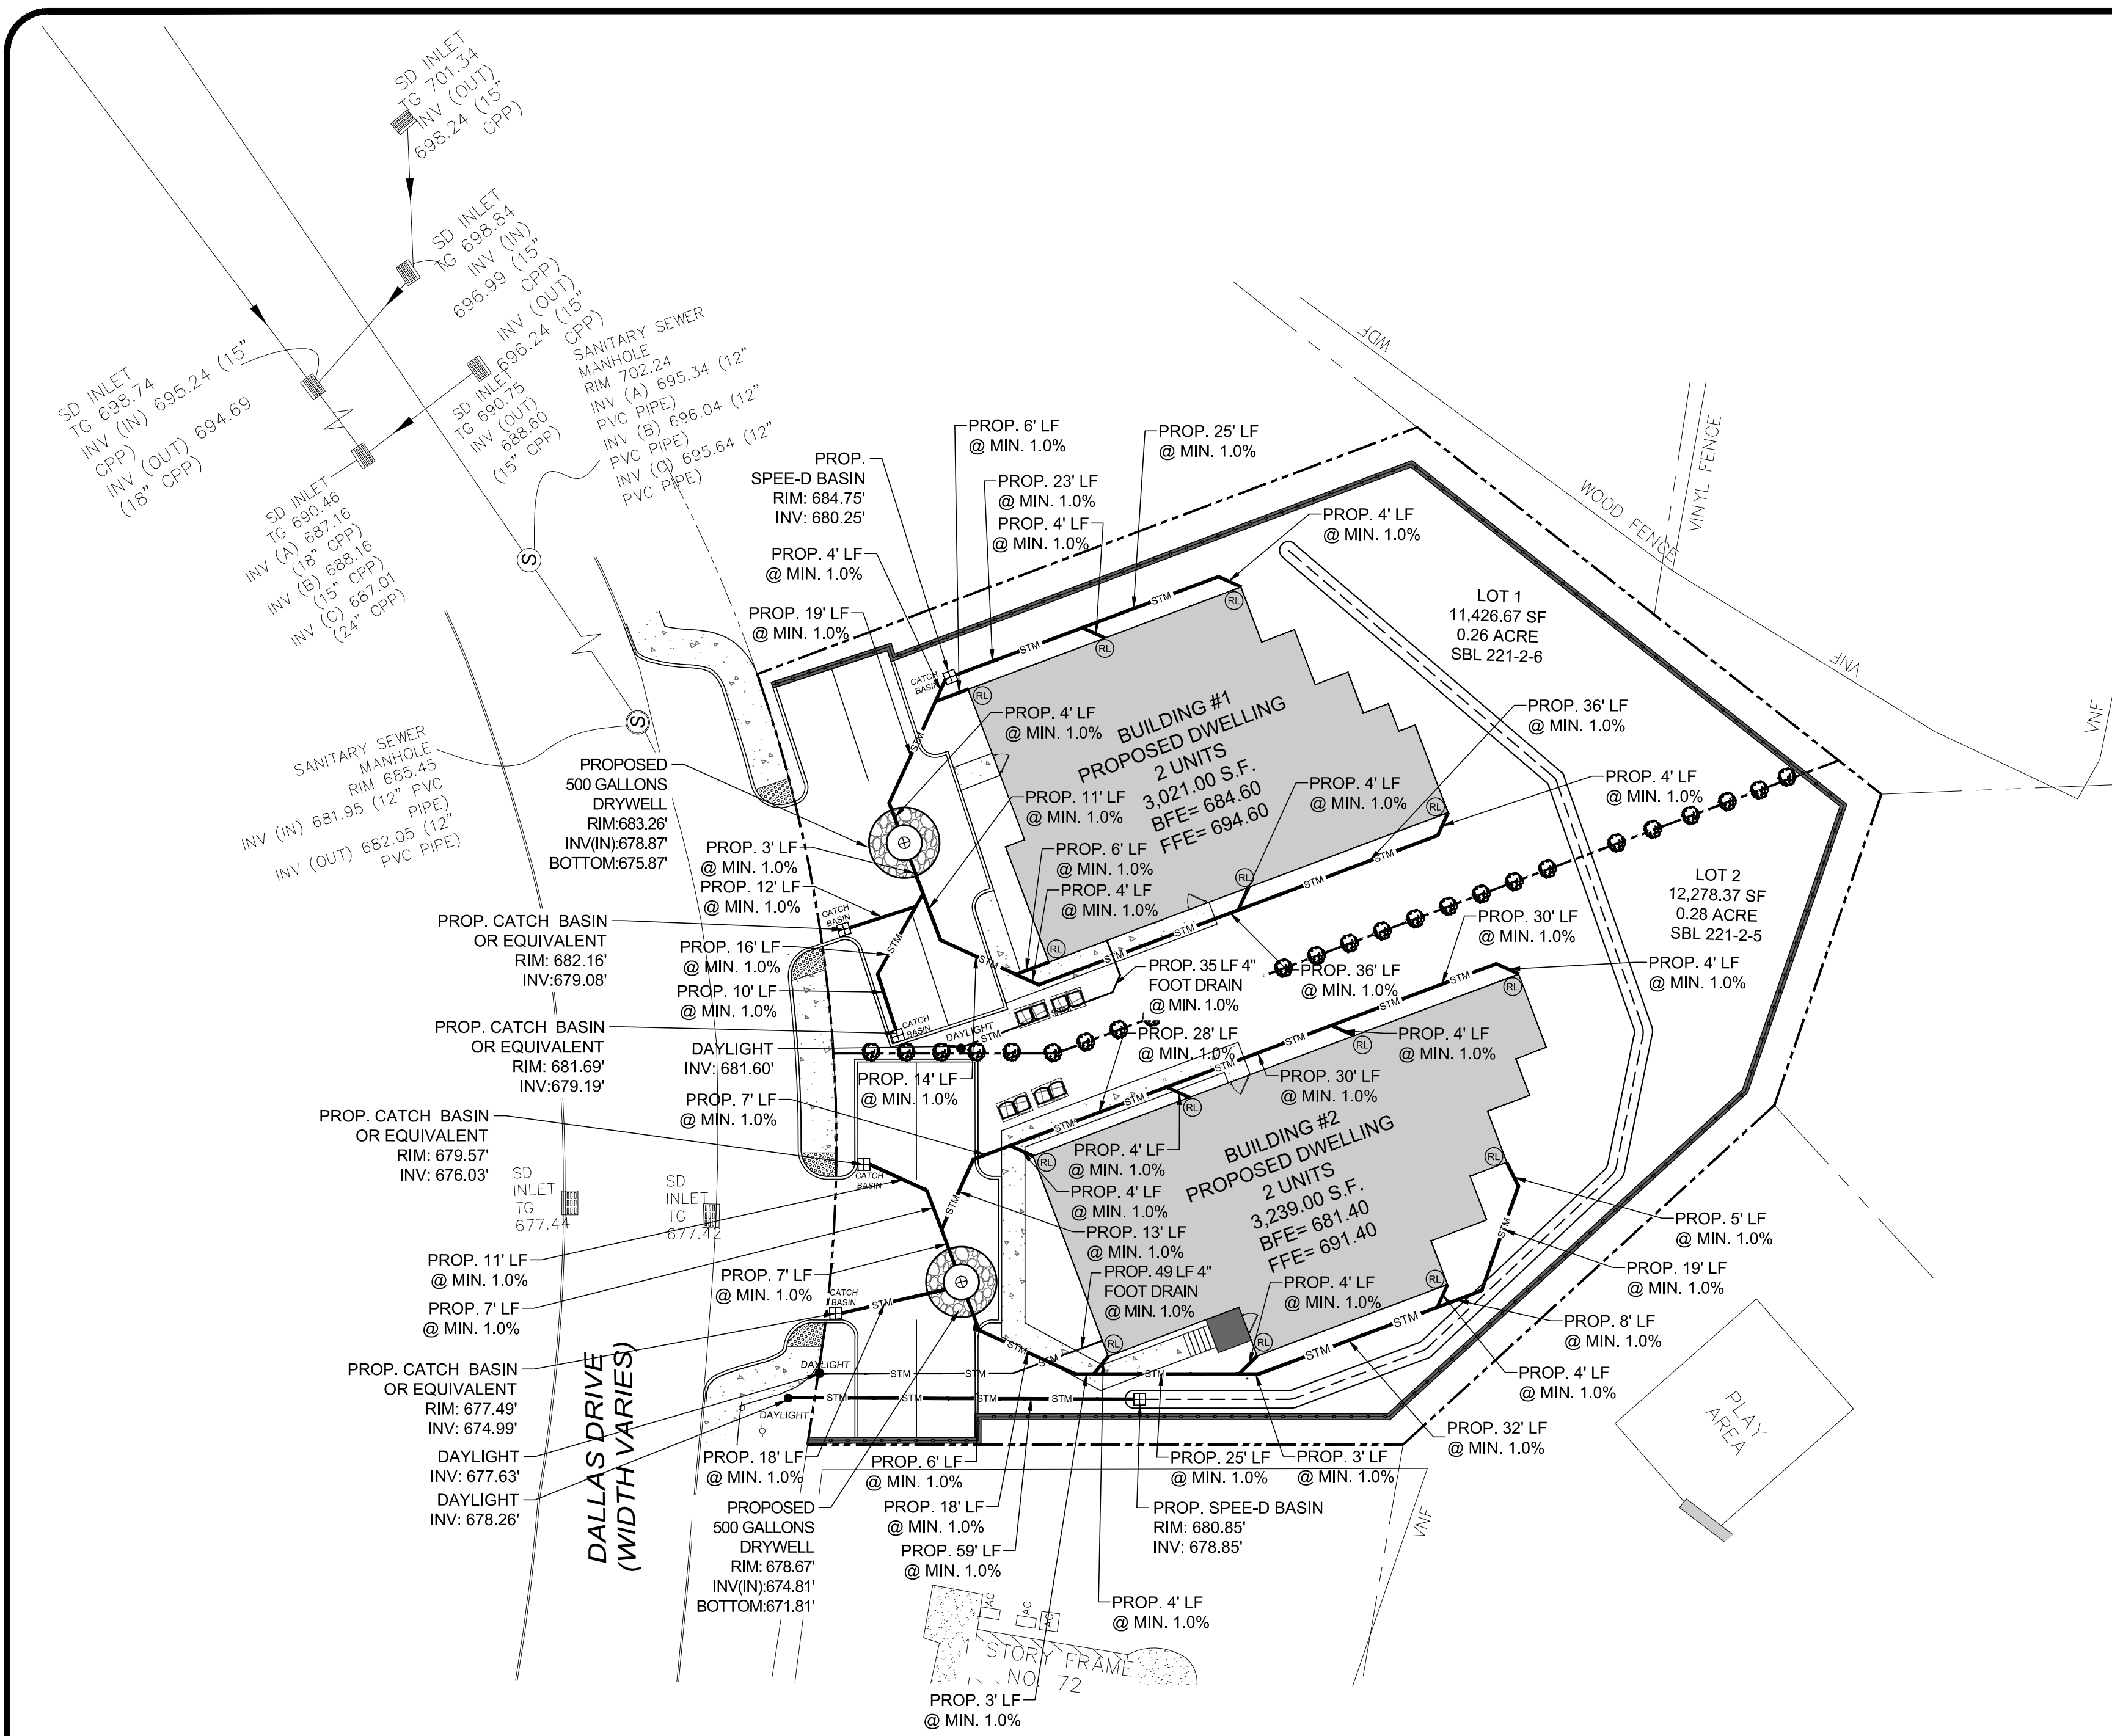

SHEA DRY WELL CYLINDRICAL 1000 GALLON STACKABLE

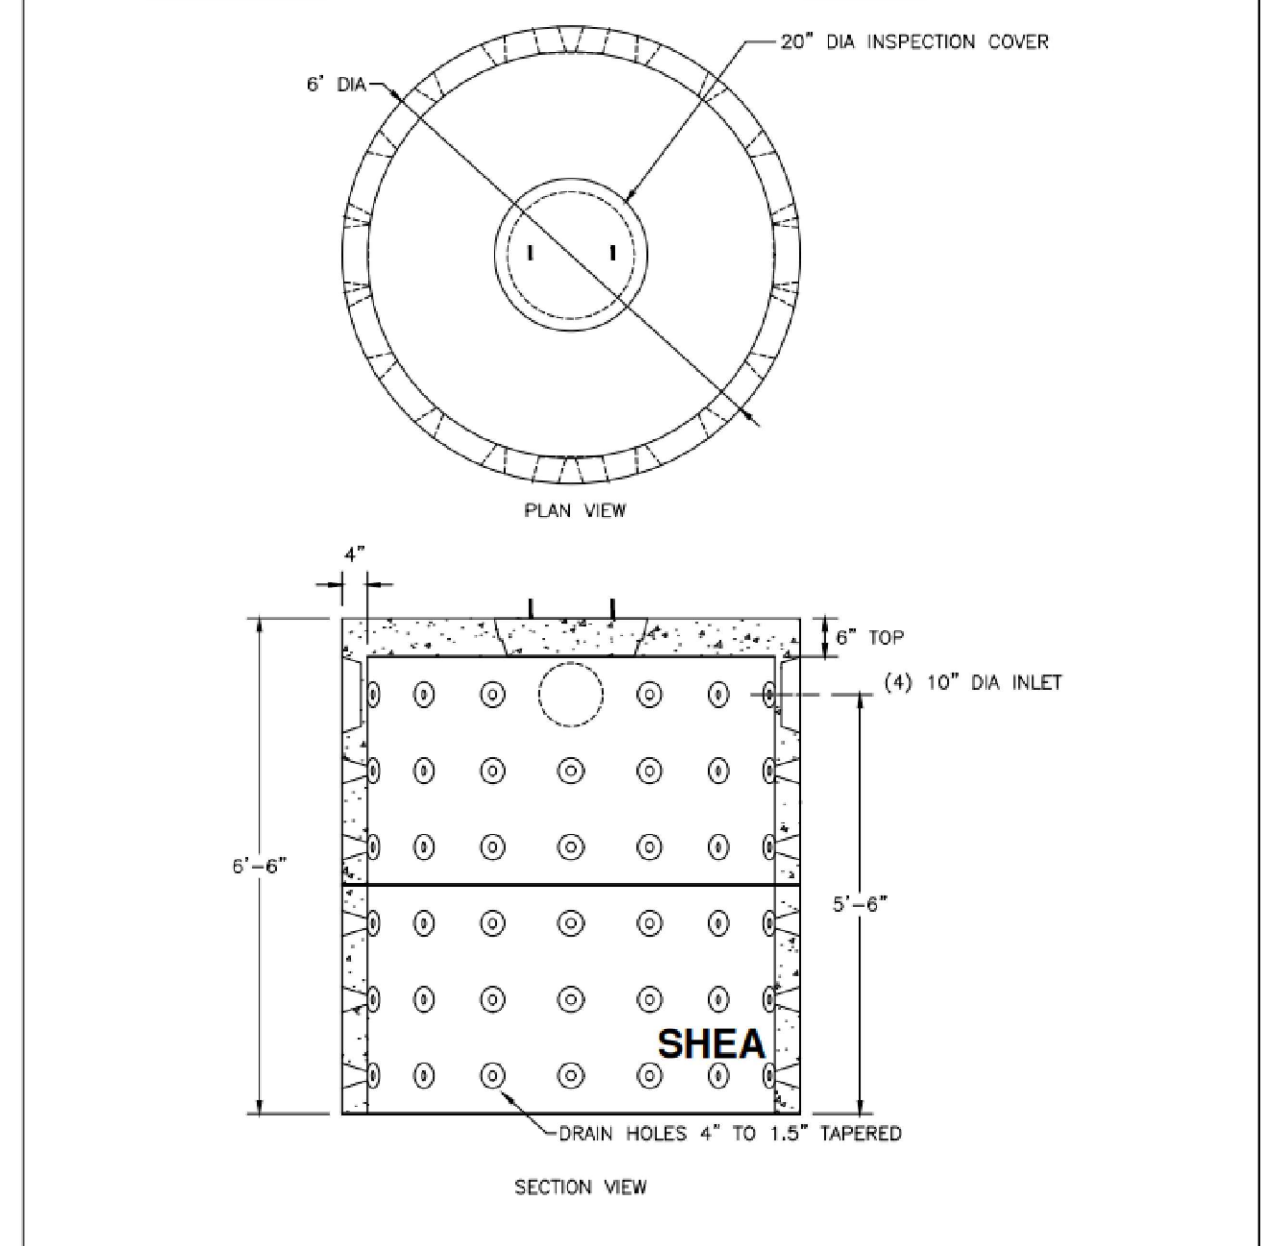


NOTES:

1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
2. ALSO AVAILABLE IN AASHTO HS-20 LOADING.
3. CAPACITY INCREASES IN INCREMENTS OF 500 GALLONS FOR EACH 3' SECTION ADDED.


ITEM NO.	STANDARD	WEIGHT
1000 GALLON	1000SDW	6,775#
500 GALLON	500SDW	3,387#
3' STACKABLE	3SS	2,000#

PREPARED FOR: FILE NAME: drc1000.dwg
 DATE: 06/01/18
 SHEA CONCRETE PRODUCTS

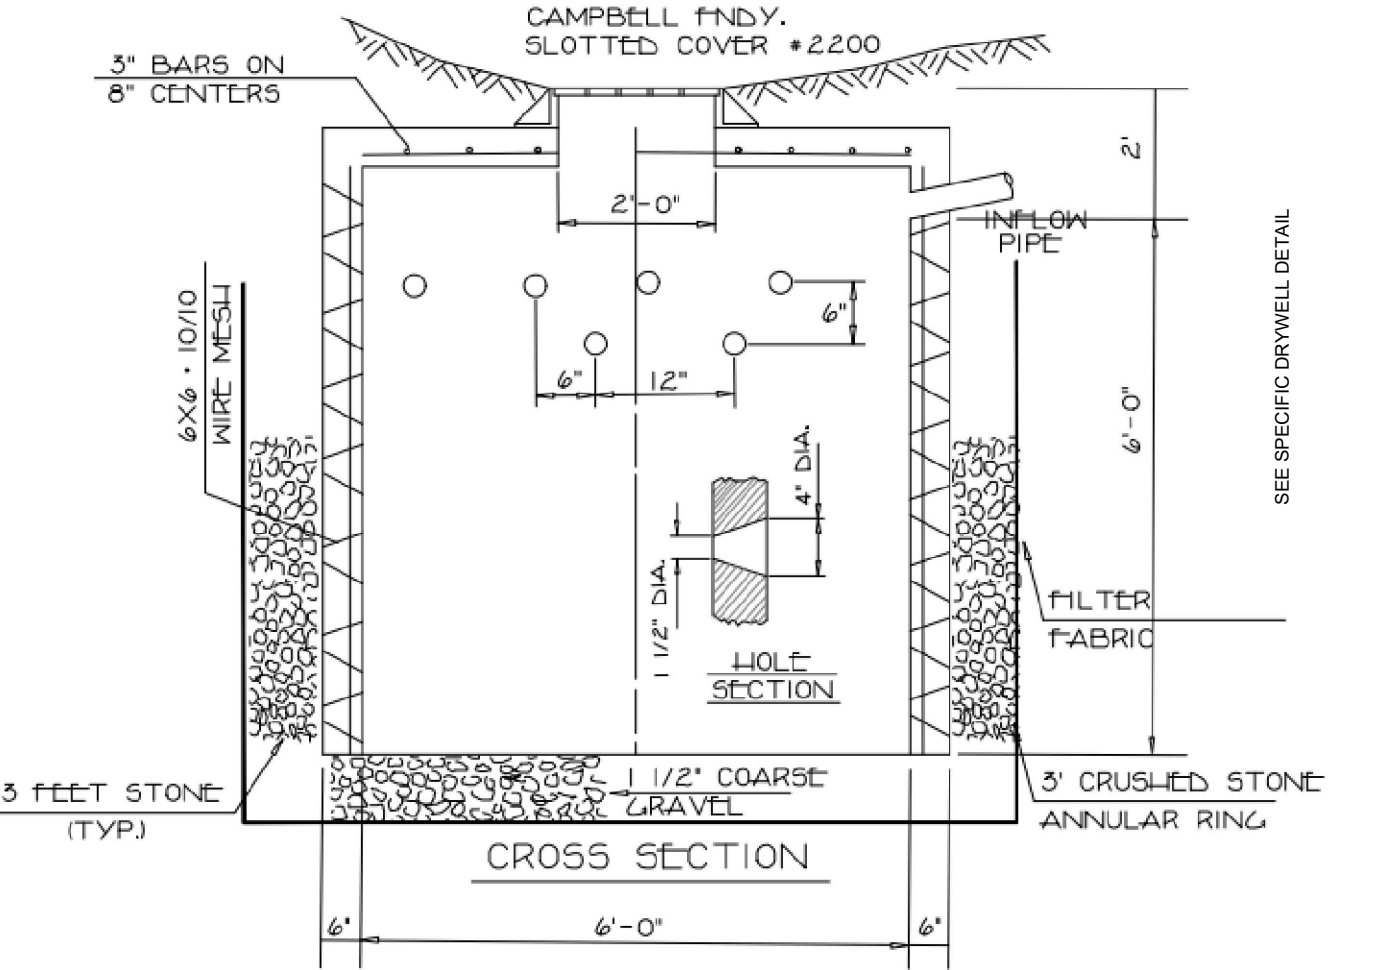

NDS DETENTION BASIN DRYWELL

SHEA DRY WELL CYLINDRICAL 500 GALLON STACKABLE


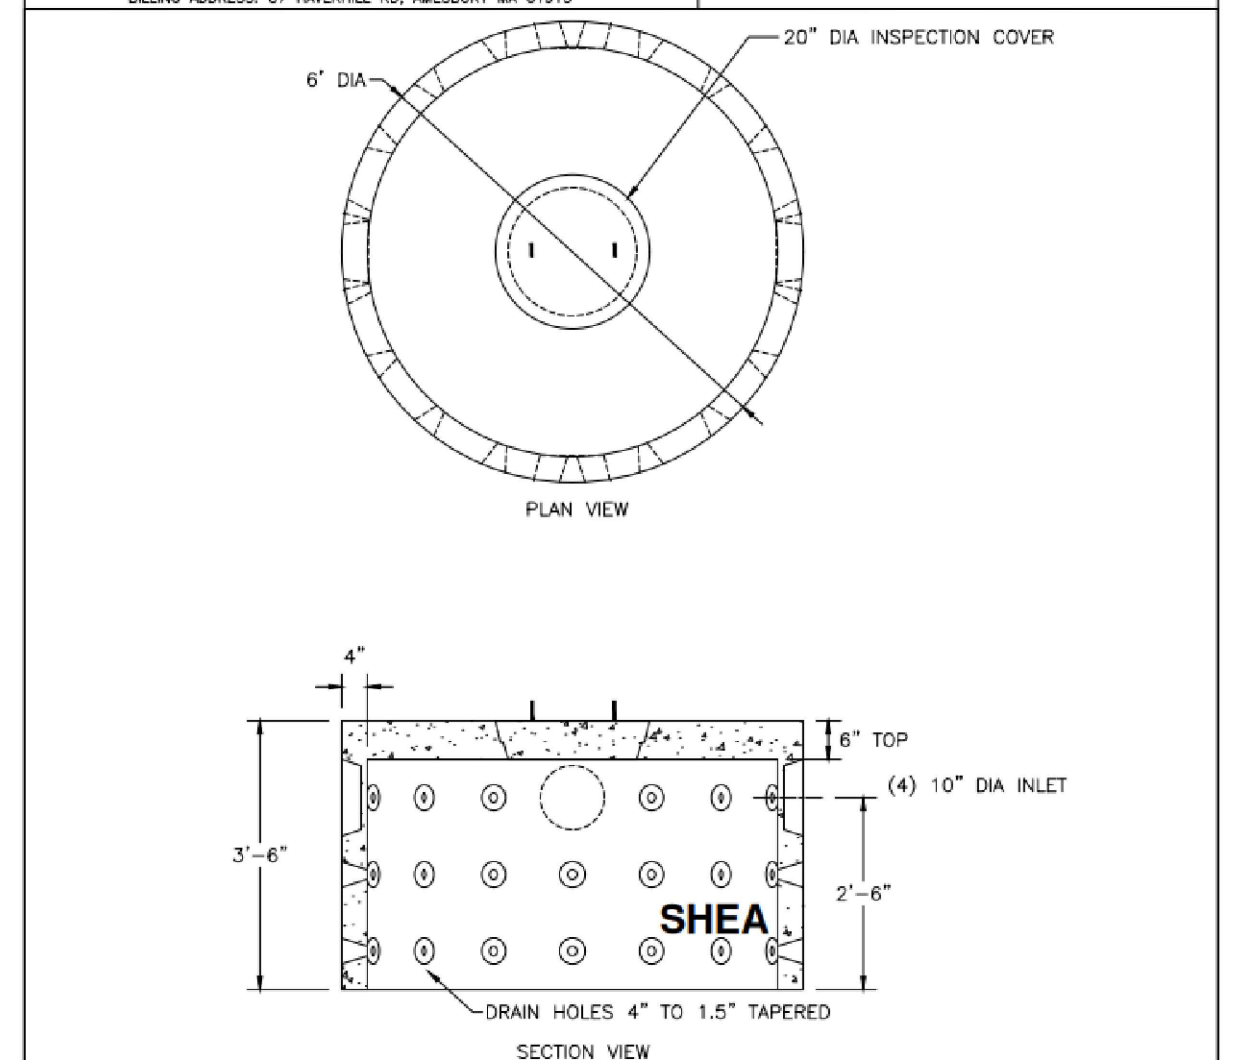


NOTES:

1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
2. ALSO AVAILABLE IN AASHTO HS-20 LOADING.
3. CAPACITY INCREASES IN INCREMENTS OF 500 GALLONS FOR EACH 3' SECTION ADDED.

ITEM NO.	STANDARD	WEIGHT
500 GALLON	500SDW	3,387#
3' STACKABLE	3SS	2,000#

PREPARED FOR: FILE NAME: drc500.dwg
 DATE: 06/01/18
 SHEA CONCRETE PRODUCTS

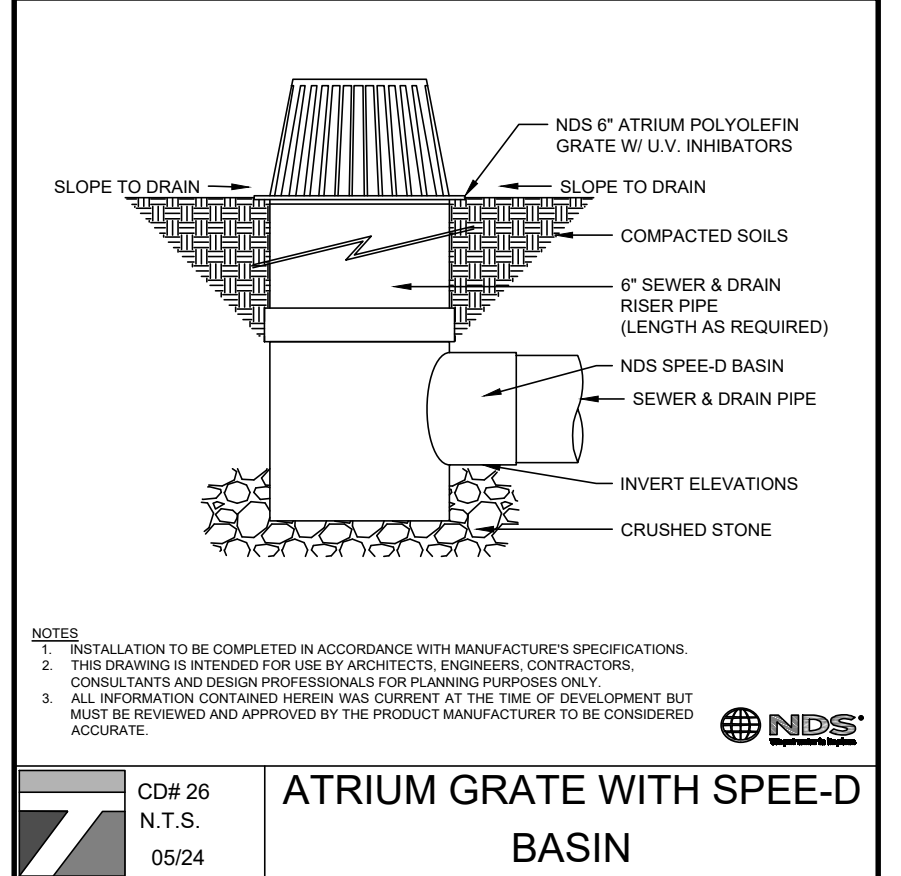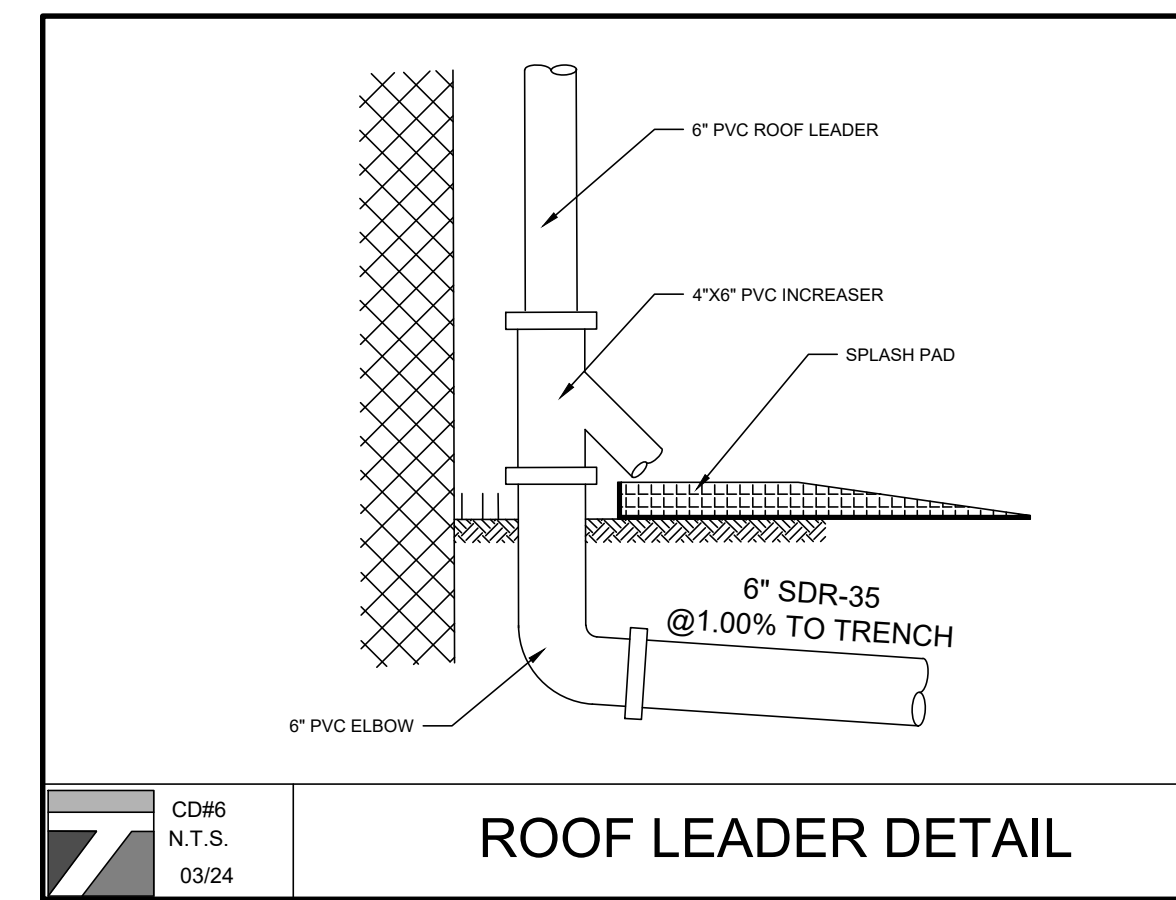

- LEGEND:**
- PROPOSED 6" PVC ROOF LEADER PER STORM DRAIN DETAILS.
 - PROPOSED 6" STM PIPE SDR-35 @ MIN 1.0% PER STORM DRAIN DETAILS. UNLESS NOTED OTHERWISE

RECHARGE NOTES:


1. RECHARGE DRYWELLS ARE TO BE LOCATED A MINIMUM OF 10-15 FEET FROM THE FOUNDATION WITH AN INVERT AT LEAST 1 FOOT LOWER THAN THE BASEMENT FLOOR
2. THE SYSTEM COLLECTS AND RECHARGES THE CLEAN RUNOFF FROM THE ROOF. IN THE EVENT THAT THE SYSTEM FAILS AND NO LONGER RECHARGES WATER, THE SYSTEM WILL OVERFLOW OUT OF THE WYE FITTING IN THE ROOF LEADER. RUNOFF WILL THEN FLOW ACROSS THE LAWN AREA WHICH IS STABILIZED WITH GRASS OR OTHER GROUND COVER. THERE SHOULD BE NO CATASTROPHIC FAILURE THAT WOULD CAUSE DAMAGING EROSION DURING NORMAL STORM EVENTS.

RUNOFF CALCULATIONS (LOT 1):

4,829.45 SF (PROPOSED COVERAGE)
 0.50 INCH/ 2 HOUR STORM
 4,829.45 SF X 0.50 IN X 1 FT/12 INCHES
 = 201.22 CF REQUIRED
 1 DRYWELL = 500 GAL = 66.84 CF
 PROPOSED STONE RING & BASE
 STONE ANNUULAR RING VOLUME (3 FT) = π x (6 FEET)² - 3 FEET² x 3 FEET
 STONE ANNUULAR RING = 254.47 CF
 STONE BASE AREA (1 FT) = π x 6 FEET² = 113.09 SQF
 STONE BASE VOLUME = 113.09 SQF X 1 FT = 113.09 CF
 TOTAL STONE = 367.56 CF
 STONE VOID = 40%
 TOTAL DETENTION VOLUME PER DRYWELL = DRYWELLS + STONE VOID
 TOTAL DETENTION VOLUME = 66.84 CF + (367.56 CF x 0.40)
 TOTAL DETENTION VOLUME = 213.86 CF
 TOTAL DRYWELL PROVIDED = 1
 TOTAL DETENTION VOLUME PROVIDED = 213.86 CF > 201.22 CF

RUNOFF CALCULATIONS DRYWELL (LOT 2):

5,242.00 SF (PROPOSED COVERAGE)
 0.50 INCH/ 2 HOUR STORM
 5,242.00 SF X 0.50 IN X 1 FT/12 INCHES
 = 218.41 CF REQUIRED
 1 PROPOSED DRYWELL = 500 GAL = 66.84 CF
 PROPOSED STONE RING & BASE
 STONE ANNUULAR RING = π x (6.5 FEET)² - 3 FEET² x 6 FEET
 STONE ANNUULAR RING = 626.74 CF
 STONE BASE AREA (1 FT) = π x 6 FEET² = 113.09 SQF
 STONE BASE VOLUME = 113.09 SQF X 2 FT = 226.18 CF
 TOTAL STONE = 892.2 CF
 STONE VOID = 40%
 TOTAL DETENTION VOLUME PER DRYWELL = DRYWELLS + STONE VOID
 TOTAL DETENTION VOLUME = 66.84 CF + (892.2 CF x 0.40)
 TOTAL DETENTION VOLUME = 423.72 CF
 TOTAL DRYWELL PROVIDED = 1
 TOTAL DETENTION VOLUME PROVIDED = 423.72 CF > 218.41 CF

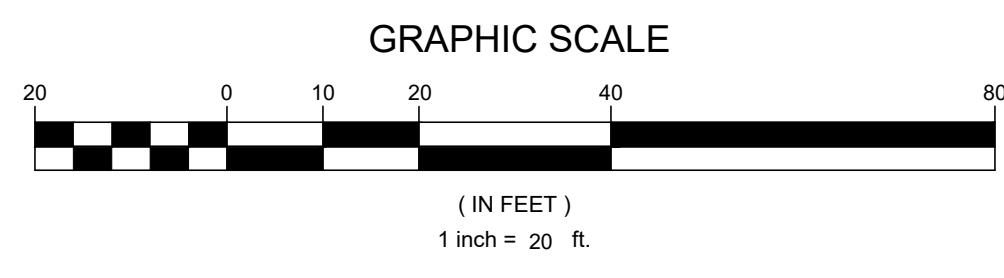

TERRANOVA ENGINEERING CONSULTANTS P.C. NEW YORK LICENSE NO. 0022576
 71 LAFAYETTE AVE., SUFFERN, NY 10901 SUITE #104 INFO@TERRANOVA.COM P.(845) 666-0155

NO.	REVISION	DATE	DR/CK

JOSIP MEDIC, PE

LIC. 103757 DATE 08/07/2025

DRAINAGE PLAN

DESIGN BY: YB	DRAWN BY: EB	CHECKED BY: JM
---------------	--------------	----------------

4 DALLAS DRIVE
 4 DALLAS DRIVE, VILLAGE OF SOUTH BLOOMING GROVE,
 ORANGE COUNTY, NEW YORK 10950
 SBL 221-2-5 & 6

DRAWING NUMBER: 04 OF 07	SCALE: 1"=20'	FILE NO.: 25155	DATE: 08/07/2025
--------------------------	---------------	-----------------	------------------



